

---

# Boiler


Tools in Action




Custom report for Tools in Action. Boiler #1

We recommend the follow items

1. Insulate pipes

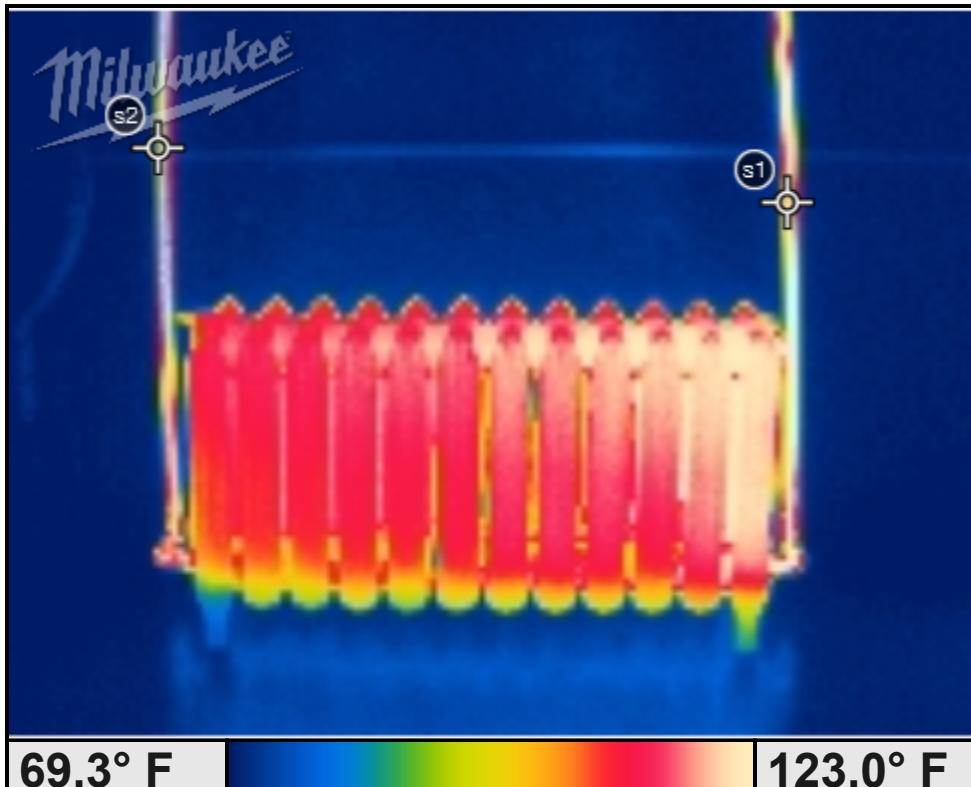

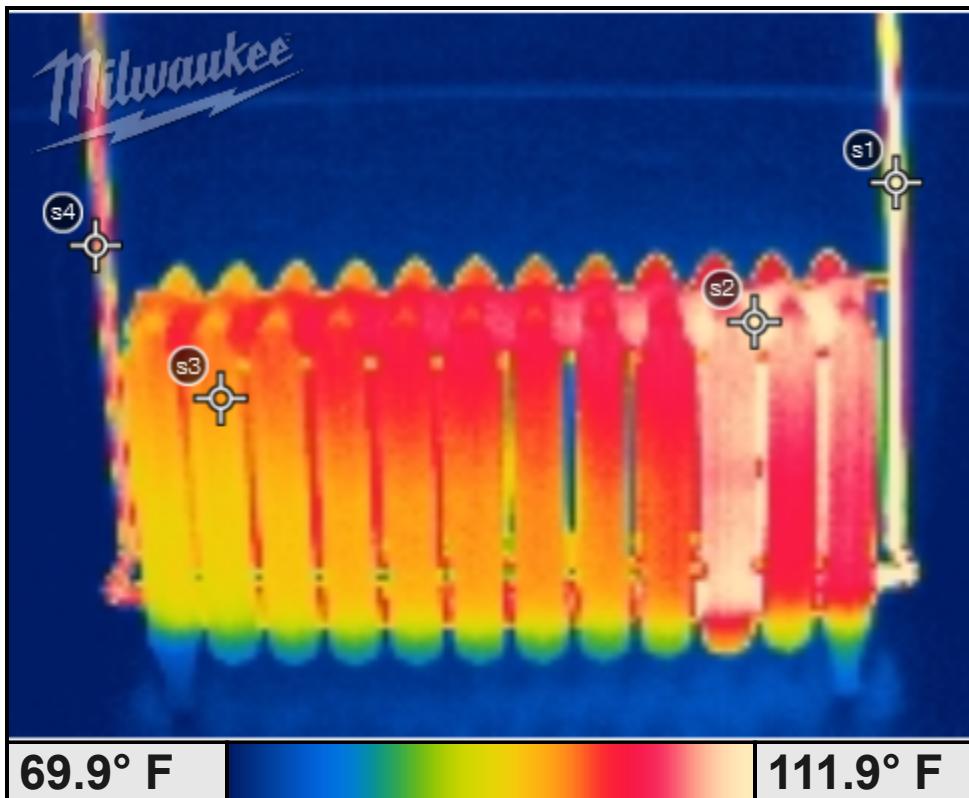**NOTES**

s1 119.0° F

s2 112.1° F

s3 97.2° F


s4 94.7° F

**PROBLEM DESCRIPTION**


24 degree loss of heat. 20% loss total



04/19/12 - 11:05 PM

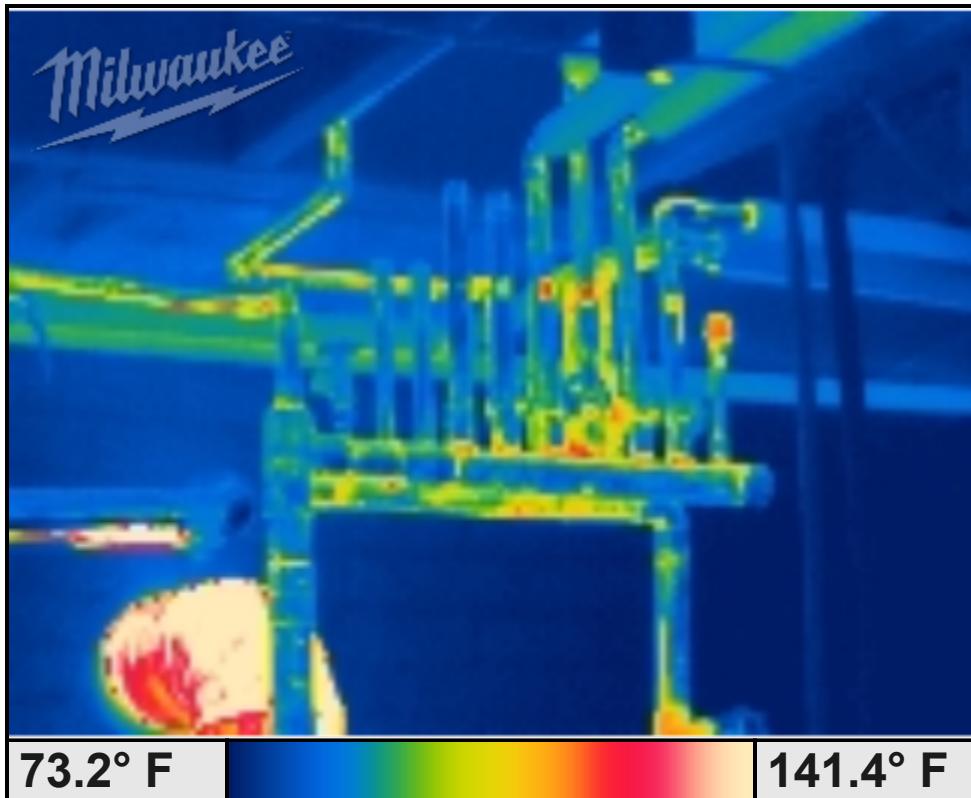

04/19/12 - 11:04 PM

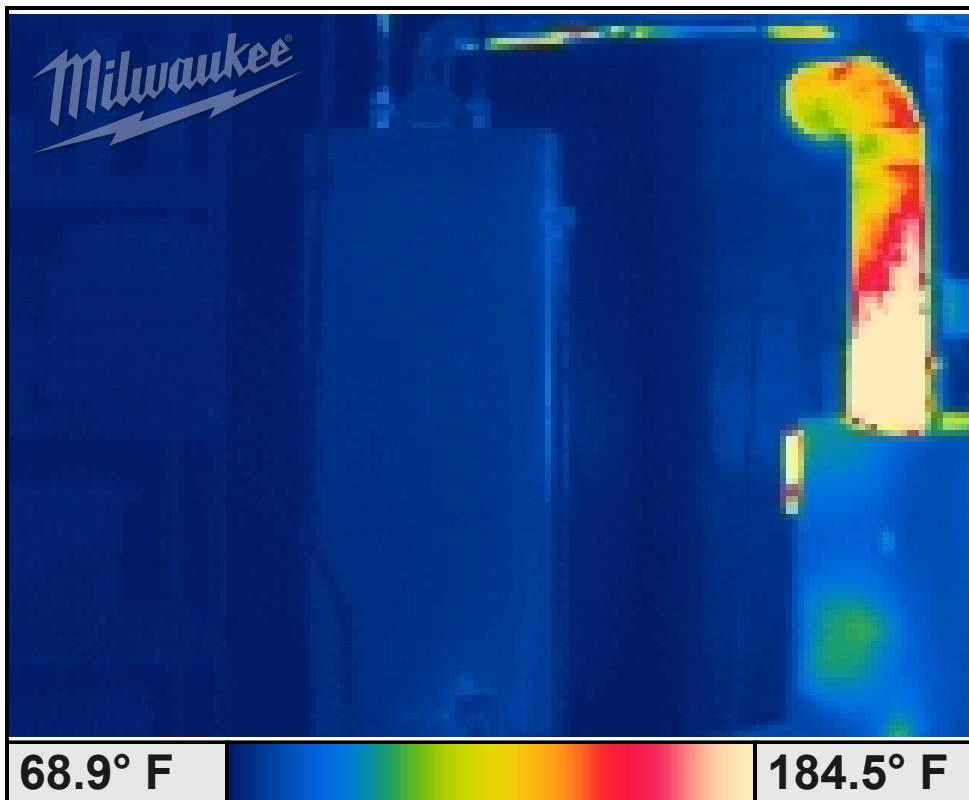

04/19/12 - 11:03 PM

